


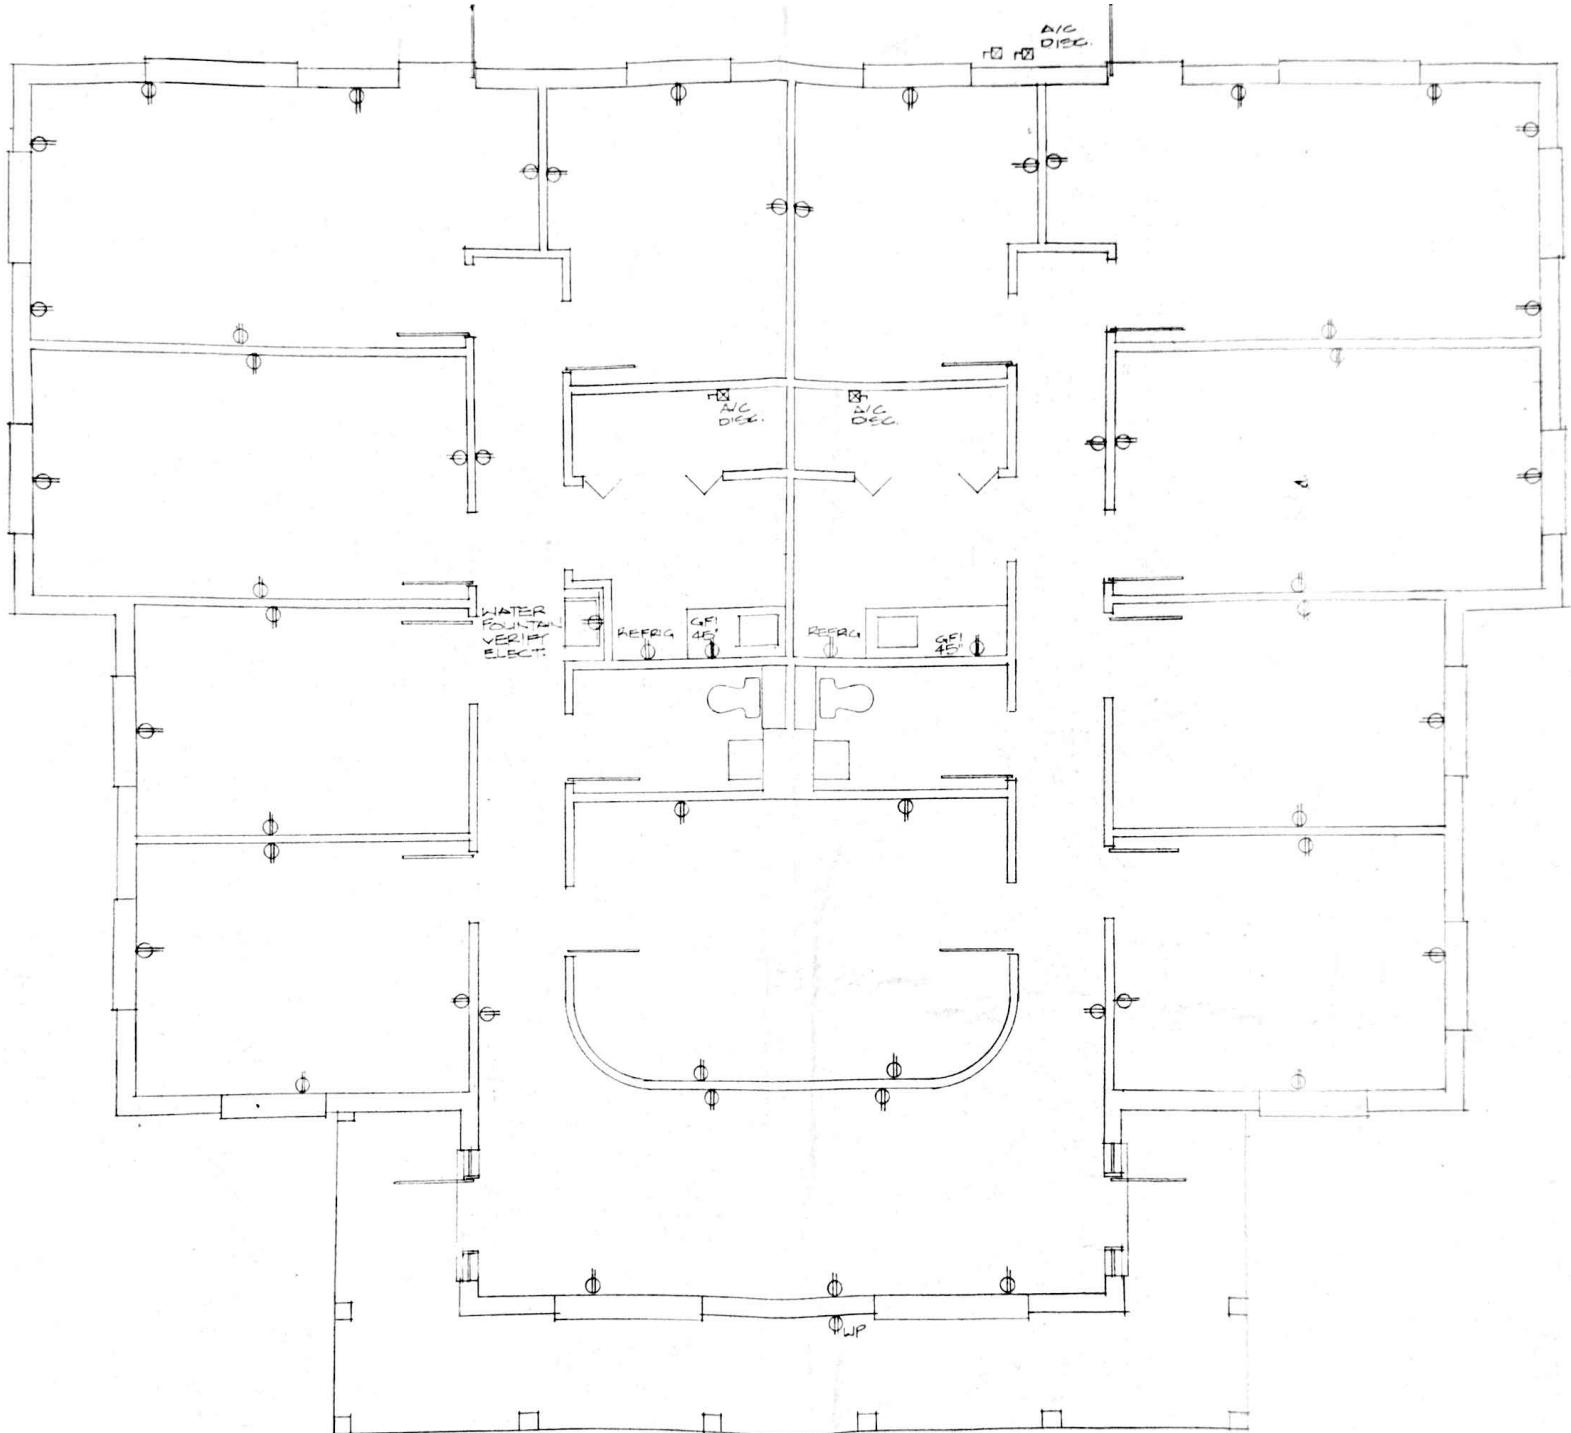

POWER PLAN

1/4" = 1'-0"

NOTES:

1. ALL WIRING SHALL CONFORM TO PINELLAS COUNTY CODES & 1980 NATIONAL ELECT. CODE.
2. ELECT. CONTR. TO PROVIDE TEMP. SITE POWER DURING CONSTRUCTION (150A, 1# 1/4 MIN.)
3. ELECT. LAYOUT PLANS SHOWN ARE DIAGRAMATIC EXACT FIXTURE LAYOUTS & WIRING ROUTINGS SHALL BE GOVERNED BY THE BUILDING'S STRUCTURAL CONDITIONS & OR OBSTRUCTIONS. ANY WIRING FOR EQUIPMENT REQUIRING INFLECTION OR MAINTENANCE SHALL BE READILY ACCESSIBLE.
4. ANY WIRING IN OR THRU PLANTING AREAS SHALL MIN. 18" BELOW FINISH GRADE / LEATHERPROOF
5. ALL ELECT. EQUIP. BREAKERS, TIME CLOCKS, ETC. TO BE PROPERLY LABELED.
6. COORDINATE INTERFACE REQUIREMENTS WITH SERVICE UTILITY FOR PARTIES RESPONSIBILITIES
7. MATERIALS & EQUIP. SHALL BE NEW & COME U.L. RATINGS
8. VERIFY LOCATION OF AIR COND. EQUIP. / WATER HEATERS, PANELS & METER
9. ALL WIRING SHALL BE THIN CU. IN EMT CONDUIT
10. ALL MATERIAL & EQUIPMENT FURNISHED TO BE GUARANTEED FOR ONE (1) YEAR FROM C.O. DATE

① JUNCTION BOX AT REMOTE SIGNAGE, VERIFY

ELECTRICAL PLANS

OFFICE BUILDING
VALK PROFESSIONAL CENTER
2600 TAMPA ROAD
PALM HARBOR FLORIDA