

ELECTRICAL SCOPE

(ELECTRICAL (I.))


NARRATIVE: REPLACE EXISTING ELECTRICAL SYSTEM WITH THE FOLLOWING:

NEW ELECTRICAL PANEL SERVICE
 • EXTEND POWER FROM HOUSE MAIN (SW CORNER) TO NEW INTERIOR SPACE CONNECT TO NEW PANEL.

NEW TENANT PANEL
 208V 3 PHASE 4 W
 SQUARE D: NQ (OR APPROVED EQUAL) RECESSED IN WALL
 42,000 AIC RATED
 SIZE: 200A MLO, 225 BUD
 FED BY: 200 A/ 3PH METER R5


ELECTRICAL NOTES

- PROVIDE AND INSTALL FIVE (5) 20 AMP CIRCUITS OF TWENTY (22) NEW DUPLEX OUTLETS - EVENLY DISTRIBUTED ACROSS CIRCUITS.
- PROVIDE AND INSTALL TWO (2) 20 AMP NEW CIRCUITS FOR 8 GFI OUTLETS IN WET LOCATIONS.
- PROVIDE AND INSTALL A NEW CIRCUIT (20 AMP) FOR POWER TO A NEW EXTERIOR SIGN.
- PROVIDE AND INSTALL A NEW CIRCUIT (20 AMP) FOR 2 NEW FLOOR OUTLETS.
- PROVIDE AND INSTALL A NEW CIRCUIT (20 AMP) FOR 3 NEW EXTERIOR WP SERVICE OUTLETS ADJACENT TO THE THE RTU.
- PROVIDE AND INSTALL 3 NEW CIRCUIT (60 AMP) FOR 3 NEW ROOF TOP UNITS (RTU) .

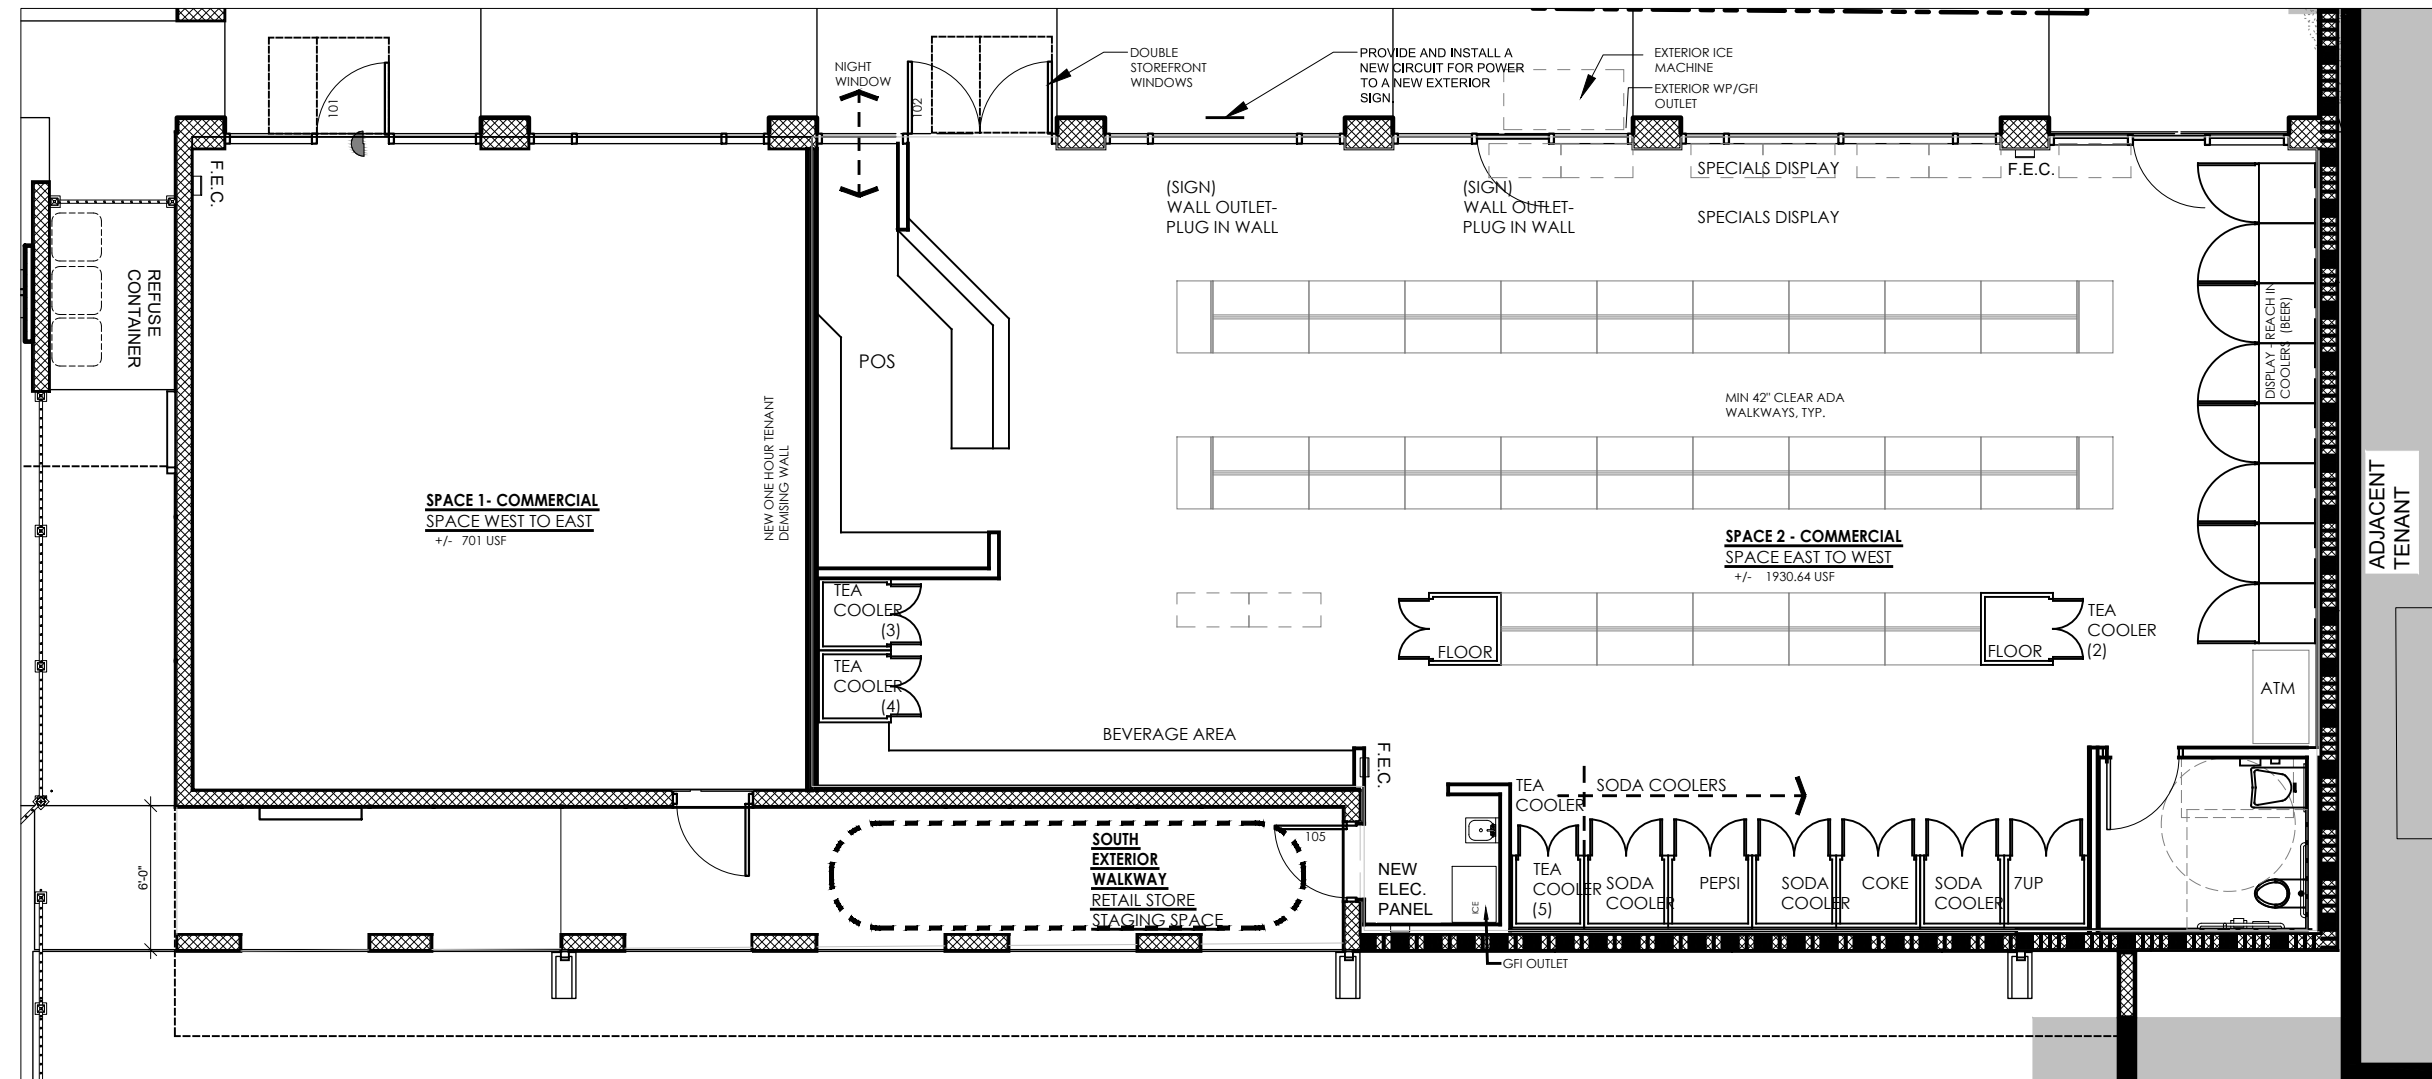

LAKE AVE - MARKET SPACE

09.08.2025
 OIA#O23-008.A



A.1