


NOTES: See Sheet 1 for Calculations, Diagrams and Symbols.  
 Circuit switch grouping as directed in compliance with code.  
 Provide Clock or "Call" control for Flood lights.  
 All fixtures & Z-B Fixtures on at all times. In each space.  
 Some Locally Switched units are indicated.

Areas excluded from Acoustical  
 are marked "D" for "Drywall"  
 or "Finished concrete or stone."

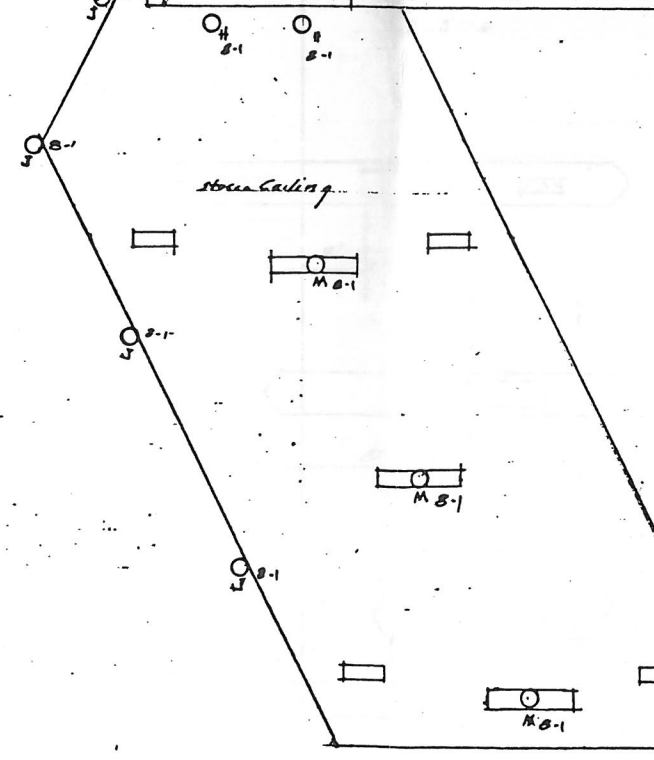

LIGHT FIXTURE SCHEDULE				CIRCUITING CIRCUIT - PANEL 21-23 - 2102	QUANTITY
MANUFACTURER	CATALOG	MOUNTING	LAMP	REMARKS	
A	DAYBRITE	SP2423RA110	LAY IN 4-40W	2x4 FLO. Lens DB12	8 2
B	DAYBRITE	SP2423RA110	LAY IN 4-40W	2x4 FLO. Lens DB 12	56 23
C	DAYBRITE	WA242 110	Surface 2-40W	15 1/4 x 9 1/8 2-240RS	6 1
D		P7154	2x1 Surface 1-40W	4 1/8 x 4 3/4 1-40W	2 2
E	KIRLIN	2004	RECESS. 50W	9 7/8 x 5 5/8 Med base E17	1 1
F	KurtVerson	C7302	RECESS. 75-150W	10 1/4 D. diam 13" H. PAR 38 Lamp	6
G	KIRLIN	1407	RECESS. 150W	Max 12" sq. Med base A21	4
H	KurtVerson	E7523	RECESS. 150W	11 1/8 Diam 12 1/2 D.	2
J	DEVOS MULTI	LIGHT	OUTDOOR wall Mount	Bank Light Red & Green signal Switching	3
K	ALKCO	2146	Dial Surface 1-40W	1-T12 4W 4 1/2 x 6 3/4 x 2 1/2 Shelf	3
L	DUAL LITE	ESR 100	Dial Surface	EXIT LITE GREEN Letters 1/4 emergency Battery	2 2
M	PARAMOUNT	1443 HL	Surface 2-T12 - 48"	4 9 1/16 x 5 1/16 x 6"	3
A17's	A	WAKEFIELD	CF4246MM	Lay IN 4-40RS WHITE LOUVER 1/2" sq	8
	B	WAKEFIELD	AF3246MM	Lay IN 2-40RS WHITE LOUVER 1/2" sq	56
	N	KIM (3 Circ)	BG-100	Pole 200W incandescent A-23 13 Foot Pole. See Site Plan	5

Flood lights. Repair existing & add to match existing. Single circuit clock controlled dimmer.  
 EXIT PANS NITONZ 2700. 2x20 CFM 3 1/4 x 10 D. Ceiling blowers on individual switches with ceiling light.  
 5 Required. 3 Bank toilets & Hospitality Room. 2 in office toilets. 1 in 1st flr.  
 Provide 1 1/4" dia. duct for each unit & one 2 1/2" dia. wall cap.  
 SIGN. CIRCUITS Place on circuit in each Pool/sw cont. or sw & clock.

Ceiling & Lighting Plan Suntree Office for  
 Landmark Bank of Brevard  
 ARCHITECTS COMM. 10. 85806

FRANCIS D. WALTON F.A.I.A. ARCHITECT  
 P.O. BOX 7555 DUNSTON BEACH FLA. 32016 TEL. 238-8615