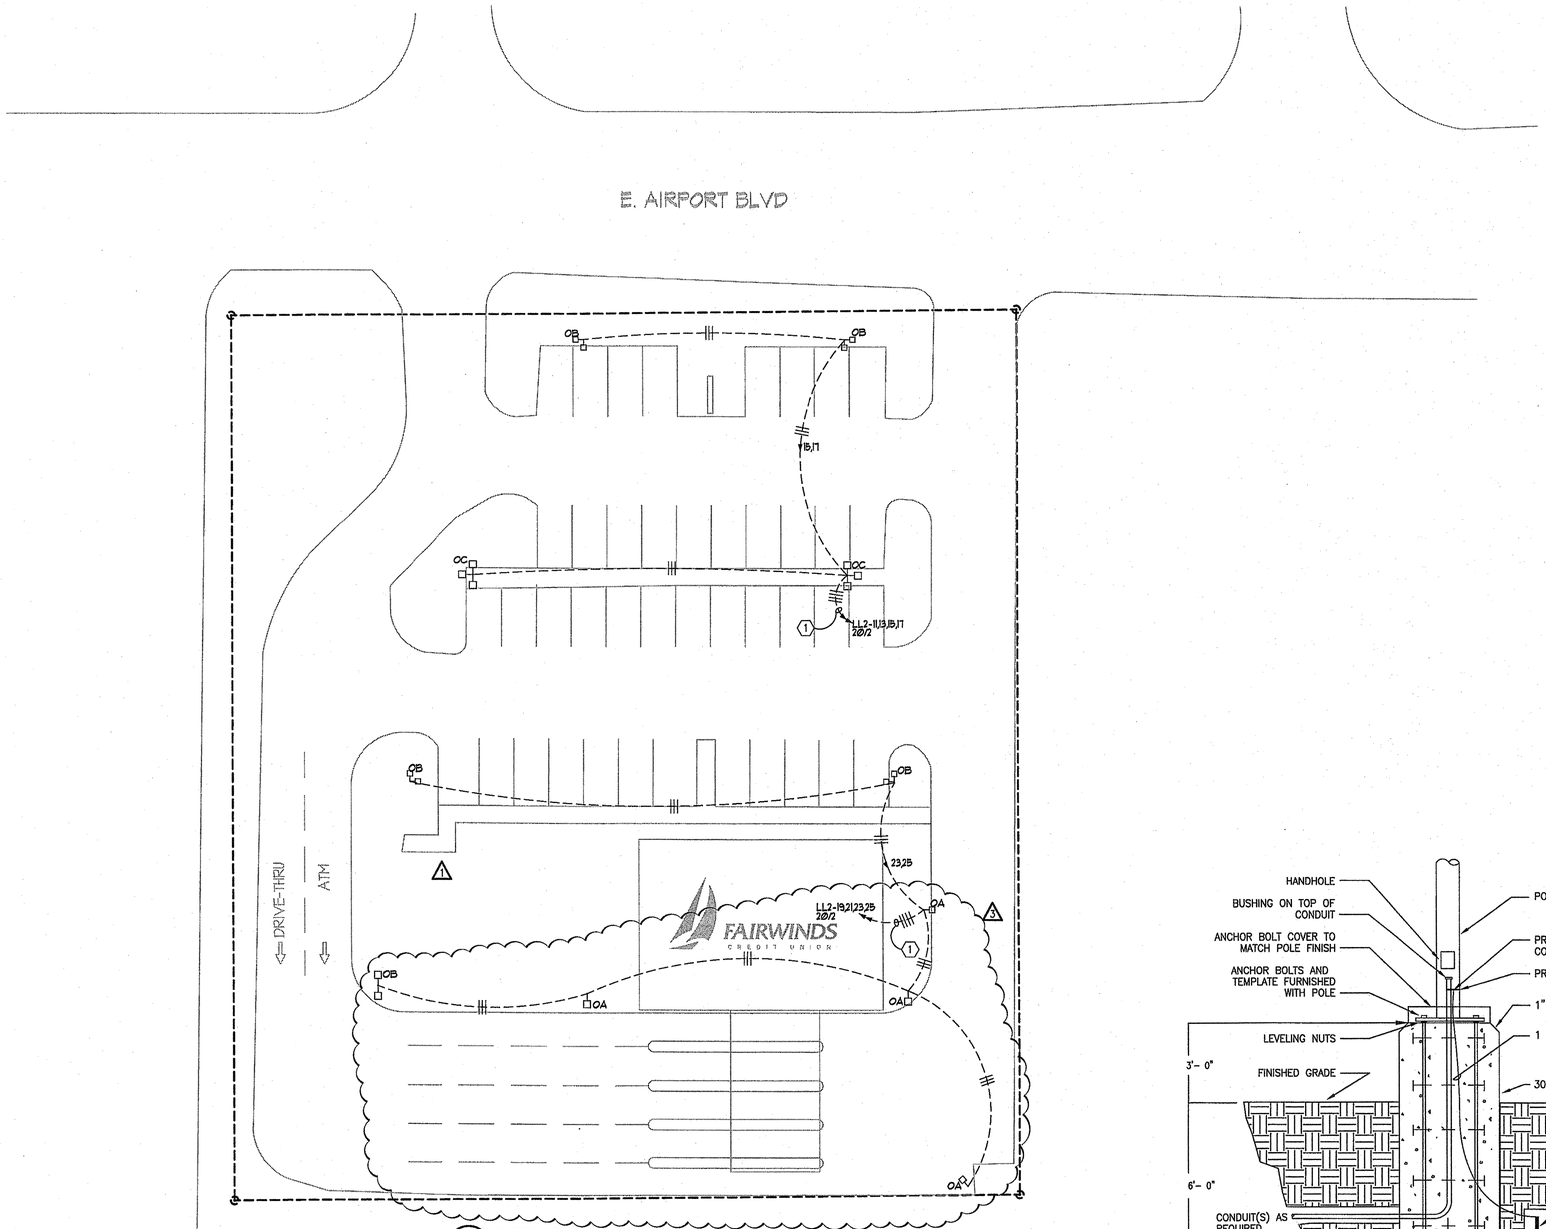

1 SITE PLAN – ELECTRICAL
E0.2 1"=20'-0"

GENERAL NOTES:
(APPLY TO THIS SHEET ONLY)

1. COORDINATE ROUTING OF ALL UNDERGROUND CONDUIT WITH CIVIL ENGINEER PRIOR TO INSTALLATION.
2. PROVIDE GROUND FOR ALL SITE LIGHTING CIRCUITS.
3. ALL SITE LIGHTING CIRCUITS SHALL BE #10'S IN 3/4" PVC CONDUIT, UNLESS NOTED OTHERWISE.

LEGEND NOTES:
(APPLY TO THIS SHEET ONLY)

(1) PROVIDE CONNECTION OF LIGHTING CIRCUIT(S) THROUGH PHOTOCELL CONTROLLED CONTACTOR TO BE LOCATED ON TOP OF ROOF.

N

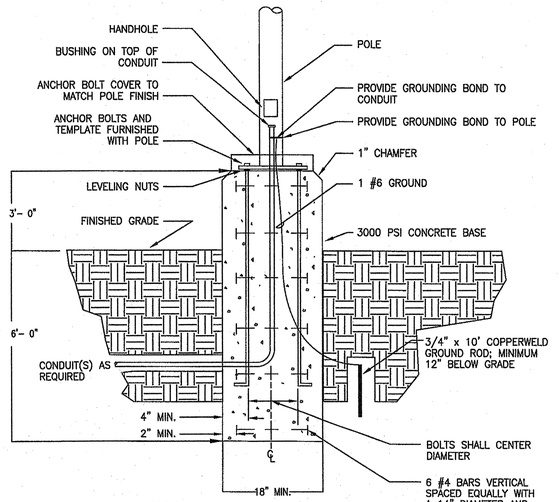

2 POLE BASE DETAIL
E0.2 NOT TO SCALE

EXTERIOR LIGHTING FIXTURE SCHEDULE

TYPE	DESCRIPTION
0A	POLE MOUNTED, SINGLE LUMINAIRE, DIE CAST H.I.D. FIXTURE. FINISH SHALL BE DARK BRONZE. POLE SHALL BE 5" SQUARE STEEL AND HAVE LENGTH REQUIRED FOR TOP OF FIXTURE TO BE 30'-0" AFF. POLE SHALL HAVE A MAXIMUM DEFLECTION OF 5 DEGREES IN WIND VELOCITIES OF 90 MPH. POLE SHALL BE MOUNTED TO CONCRETE COLUMNS. REFER TO POLE BASE DETAIL ON 2/E0.2 PROVIDE AS 208V. TYPE 3 DISTRIBUTION ASYMMETRIC. LAMPS: (1) 400MVR/C/BT-37 MANF: LITHONIA – KAD-400M-R3 OR EQUAL BY LSI, MCGRAW EDISON, GARDCO
0B	SAME AS TYPE '0A' EXCEPT PROVIDE WITH DOUBLE LUMINAIRES AT 180° APART.
0C	SAME AS TYPE '0A' EXCEPT PROVIDE WITH TRIPLE LUMINAIRES AT 90° APART.

KDA | Holdings
Building on Ideas
350 Franklin Road
Marietta, GA 30067
Phone: 770.421.1532
Fax: 770.422.8285

Warner Summers Ditzel Benefield Ward & Associates
ARCHITECTURE & INTERIOR DESIGN
67 PEACHTREE PARK DRIVE ATLANTA, GA 30309
(404) 352-6072 FAX (404) 352-0281

WSDBW NO. 06091

FAIRWINDS CREDIT UNION
Sanford, Branch

Issue:

Date	Rev.	Description
3/30/07		C.D. Presentation
5/25/07		Coordination Set
8/03/07	1	Electrical Revision Set
8/14/07	2	Site Light Clarification

KDA Project Number: (BWA - 07004) 27-0001
Drawn By: DSW
Checked By: CMV
Scale: AS NOTED

SITE PLAN - ELECTRICAL

E0.2